


SLP (UK) LTD

20-Arowlite-polycarbonate

INTENSITY VALUES CANDELAS PER 1000 LUMENS

	0	15	30	45	60	75	90
0	318.39	318.39	318.39	318.39	318.39	318.39	318.39
5	325.50	322.88	311.32	310.88	316.37	324.92	325.54
10	317.71	305.16	311.47	309.31	317.15	312.25	305.99
15	302.62	300.53	300.62	295.41	306.72	295.83	308.43
20	289.07	284.10	296.57	283.29	283.08	282.41	291.00
25	272.90	277.66	273.15	271.62	269.14	269.44	274.77
30	260.43	259.38	249.03	253.03	251.56	259.74	257.66
35	229.83	234.21	230.62	229.12	229.02	229.07	232.97
40	214.84	207.56	215.76	206.10	207.48	207.73	214.90
45	185.72	193.90	188.11	190.30	191.25	190.66	184.77
50	171.18	171.23	165.74	165.08	169.90	163.33	170.26
55	142.47	139.57	141.03	143.27	142.56	139.55	144.74
60	116.80	120.60	116.85	117.28	115.42	120.57	118.38
65	98.74	94.23	96.85	95.06	96.99	97.59	95.07
70	69.81	71.12	69.69	69.45	71.26	68.61	69.21
75	45.83	46.54	45.25	46.17	45.76	47.54	46.61
80	25.12	25.02	25.80	26.43	25.47	26.46	26.30
85	7.22	7.39	8.14	8.10	8.15	8.53	8.81
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0

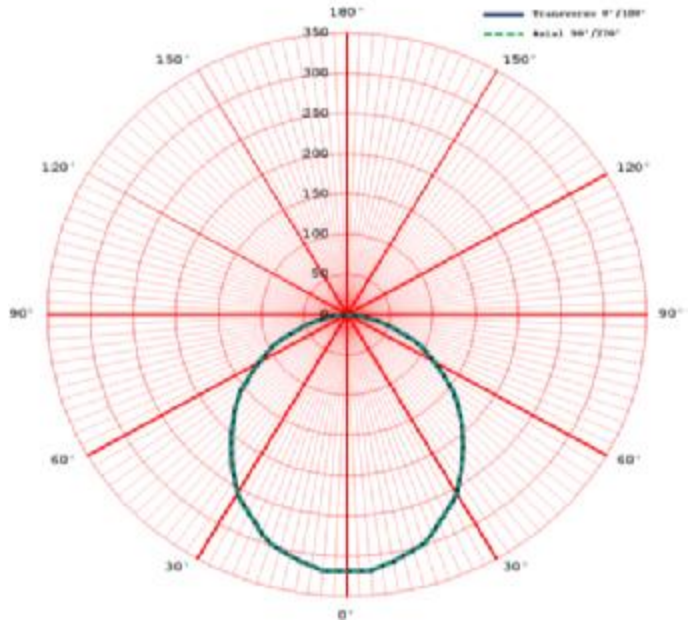

Spacing To Mounting Height Ratio

Nominal S/Hm.	1.25
Maximum S/Hm.	1.38
Maximum Transverse S/Hm.	-

Light Output Ratio's

Upward Light Output	ULOR	0%
Downward Light Output	DLOR	0.82%
Total	LOR	0.82%

Utilisation Factors for a Nominal S/Hm. of 1.5

Ceiling	Walls	Floor	Room Index								
			0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
70%	50%	20%	.48	.56	.62	.66	.72	.76	.79	.83	.85
	30%		.42	.50	.56	.61	.67	.72	.75	.79	.82
	10%		.37	.45	.52	.56	.63	.68	.72	.77	.80
50%	50%	20%	.46	.55	.60	.64	.70	.73	.76	.79	.82
	30%		.41	.49	.55	.59	.66	.70	.73	.77	.79
	10%		.37	.45	.51	.56	.62	.67	.70	.74	.77
30%	50%	20%	.45	.53	.58	.62	.67	.71	.73	.76	.78
	30%		.40	.48	.54	.58	.64	.68	.71	.74	.77
	10%		.36	.54	.50	.55	.61	.65	.68	.72	.75
0%	0%	0%	0.35	0.43	0.46	0.48	0.51	0.53	0.54	0.56	0.57
BZ CLASSIFICATION			4	4	4	4	4	4	4	4	4

All Photometry conducted in accordance to BS5225:Part 1:1975

Calculations conducted to CIBSE TM5 & TM10

Uncorrected Glare Indices available upon request