


SLP (UK) LTD

P1 SPECULAR SILVER 15/15/11

INTENSITY VALUES CANDELAS PER 1000 LUMENS

	0	15	30	45	60	75	90
0	185.3	185.3	185.3	185.3	185.3	185.3	185.3
5	192.3	190.9	191.0	189.3	187.1	185.8	185.3
10	195.9	195.9	196.2	194.8	190.7	184.9	182.6
15	189.1	188.1	190.3	192.0	190.2	182.6	177.2
20	193.6	190.6	186.4	182.1	183.3	178.4	169.3
25	192.9	193.0	189.3	178.6	172.1	170.7	160.8
30	184.7	182.4	180.5	175.8	162.2	159.8	149.7
35	184.2	182.1	173.2	165.1	153.7	145.2	136.3
40	178.1	175.3	166.2	152.3	141.0	128.1	121.0
45	162.3	152.8	132.1	122.8	105.5	98.7	94.1
50	38.5	73.4	63.8	77.2	44.1	52.4	17.2
55	0.0	48.0	3.9	40.4	2.4	21.5	0.0
60	0.0	2.6	0.0	8.4	0.0	1.1	0.0
65	0.0	0.0	0.0	0.3	0.0	0.0	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0
75	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0

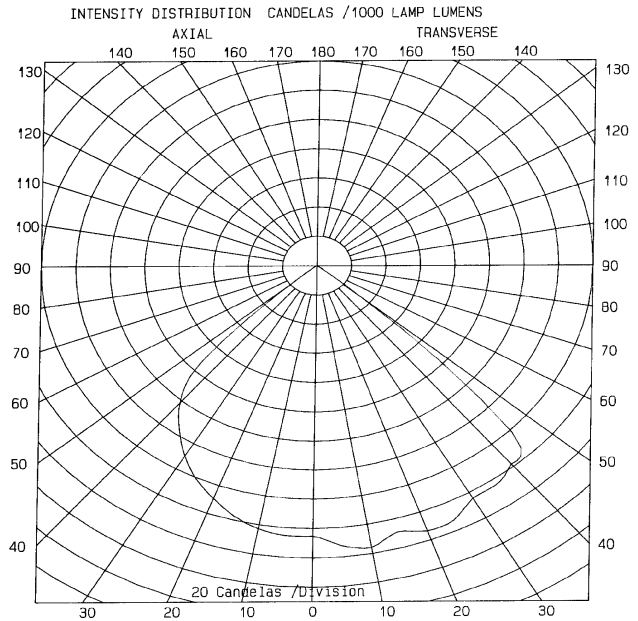

Spacing To Mounting Height Ratio

Light Output Ratio's

Nominal S/Hm.	1.25
Maximum S/Hm.	1.25
Maximum Transverse S/Hm.	2.09

Upward Light Output ULOR	0%
Downward Light Output DLOR	36.5%
Total LOR	36.5%

Utilisation Factors for a Nominal S/Hm. of 1.5

		Room Index									
Ceiling	Walls	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
70%	50%	20%	0.27	0.31	0.33	0.35	0.36	0.38	0.39	0.40	0.40
	30%		0.25	0.29	0.31	0.33	0.35	0.36	0.37	0.39	0.39
	10%		0.23	0.27	0.30	0.31	0.34	0.35	0.36	0.38	0.39
50%	50%	20%	0.27	0.3	0.32	0.34	0.35	0.36	0.37	0.38	0.38
	30%		0.25	0.28	0.31	0.32	0.34	0.35	0.36	0.38	0.38
	10%		0.23	0.27	0.29	0.31	0.33	0.34	0.35	0.37	0.37
30%	50%	20%	0.26	0.29	0.31	0.33	0.34	0.35	0.36	0.37	0.37
	30%		0.24	0.28	0.30	0.32	0.33	0.35	0.35	0.37	0.37
	10%		0.23	0.27	0.29	0.31	0.32	0.34	0.35	0.36	0.36
0%	0%	0%	0.23	0.26	0.28	0.30	0.31	0.32	0.33	0.34	0.35
BZ CLASSIFICATION			1	1	1	1	1	1	1	1	1

All Photometry conducted in accordance to BS5225:Part 1:1975
Calculations conducted to CIBSE TM5 & TM10

Uncorrected Glare Indices available upon request