


SLP (UK) LTD

P7 SPECULAR SILVER 20x20x15 mm

INTENSITY VALUES CANDELAS PER 1000 LUMENS

	0	15	30	45	60	75	90
0	205.3	205.3	205.3	205.3	205.3	205.3	205.3
5	207.8	207.8	207.4	206.1	204.7	204.0	203.6
10	209.9	210.5	209.1	206.8	203.7	201.5	200.4
15	207.6	207.7	206.4	204.5	200.6	196.4	194.2
20	207.8	207.1	203.4	198.2	194.7	189.2	185.6
25	206.9	205.7	200.0	192.1	185.5	180.6	176.1
30	203.4	202.2	195.1	185.9	175.3	170.1	163.8
35	189.2	189.2	183.9	176.7	164.0	155.8	148.5
40	173.0	171.4	165.4	159.7	146.5	134.6	127.2
45	143.3	143.1	136.4	129.7	116.4	107.9	102.3
50	94.5	106.0	90.3	91.6	78.9	79.0	62.7
55	47.5	74.7	45.8	67.3	38.3	53.1	33.9
60	17.2	39.0	12.8	30.8	10.5	28.0	13.7
65	0.0	13.0	0.7	8.5	0.4	9.8	0.0
70	0.0	2.0	0.0	0.3	5.8	1.0	0.0
75	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0

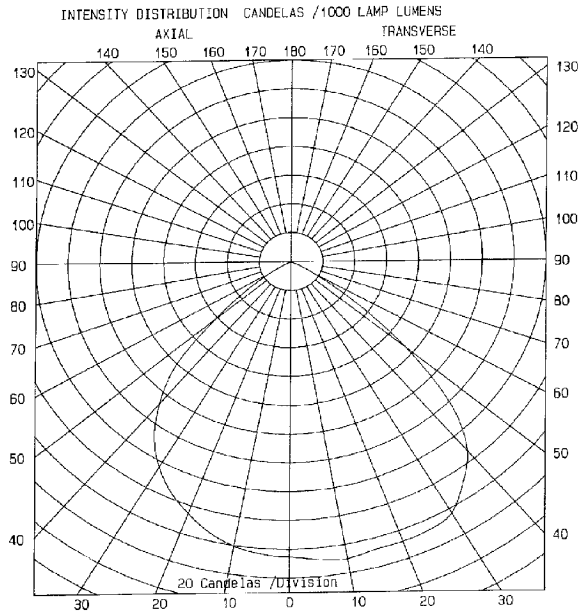

Spacing To Mounting Height Ratio

Light Output Ratio's

Nominal S/Hm.	1.50
Maximum S/Hm.	1.72
Maximum Transverse S/Hm.	1.99

Upward Light Output ULOR	0%
Downward Light Output DLOR	42.5%
Total LOR	42.5%

Utilisation Factors for a Nominal S/Hm. of 1.5

		Room Index									
Ceiling	Walls	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
70%	50%	20%	0.32	0.36	0.38	0.40	0.42	0.44	0.44	0.46	0.46
	30%		0.30	0.34	0.36	0.38	0.40	0.42	0.43	0.45	0.45
	10%		0.28	0.32	0.35	0.37	0.39	0.41	0.42	0.44	0.45
50%	50%	20%	0.32	0.35	0.37	0.39	0.41	0.42	0.43	0.44	0.45
	30%		0.30	0.33	0.36	0.37	0.40	0.41	0.42	0.43	0.44
	10%		0.28	0.32	0.34	0.36	0.38	0.40	0.41	0.42	0.43
30%	50%	20%	0.31	0.34	0.37	0.38	0.40	0.41	0.42	0.43	0.43
	30%		0.29	0.33	0.35	0.37	0.39	0.40	0.41	0.42	0.43
	10%		0.28	0.31	0.34	0.35	0.38	0.39	0.40	0.41	0.42
0%	0%	0%	0.27	0.30	0.33	0.34	0.36	0.38	0.38	0.39	0.40
BZ CLASSIFICATION			1	1	1	1	1	1	1	1	1

All Photometry conducted in accordance to BS5225:Part 1:1975
Calculations conducted to CIBSE TM5 & TM10

Uncorrected Glare Indices available upon request